


# RESIDENTIAL WATER SERVICE

DOUBLE SERVICE\*\*\*

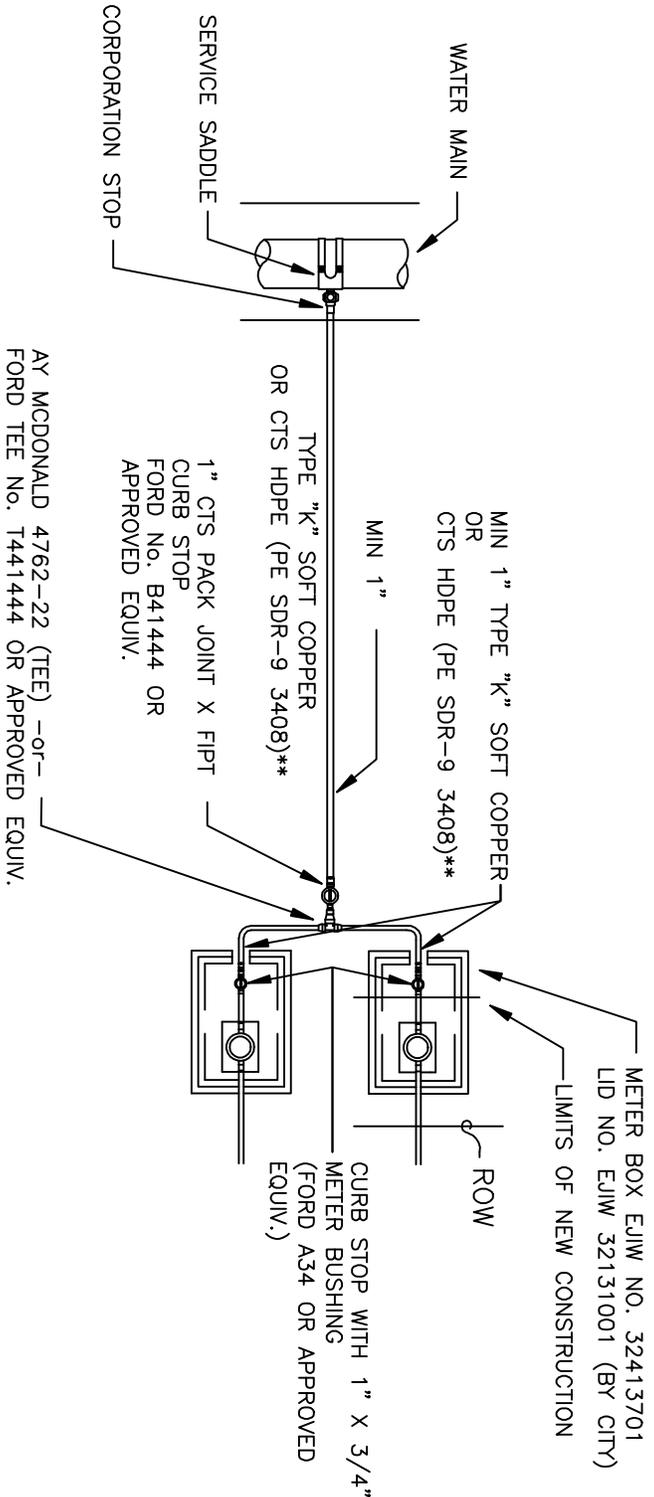

## DOUBLE SERVICE CONNECTION FITTINGS \*

SERVICE SADDLE	CORPORATION STOP	CURB STOP
FORD FC-202	F1000-4	B43444W
MUELLER DR2S	P15008	P24350
MCDONALD --	4701-22	6100M-22

\* OR APPROVED EQUIVALENT MANUFACTURER

\*\*\* DOUBLE SERVICE SHALL SUPPORT A MAXIMUM OF TWO METERS

\*\* HDPE SERVICES SHALL BE GRADE "A" VIRGIN MATERIAL, SLEEVED IN SCH 40 PVC, AND BEDDED IN SAND 3" ABOVE AND 3" BELOW PIPE

SHEET 1 OF 1

**CITY OF TEMPLE  
ENGINEERING DEPARTMENT**

2210 E. Avenue H, Bldg. A

TEMPLE, TX 76801-8462

**DOUBLE RESIDENTIAL  
WATER SERVICE DETAIL**

SCALE:  
N.T.S.



APPROVED BY: Michael Newman, P.E.

DESIGN APPROVED DATE:

DRAWN BY: Chris Paul

FILE NAME: DOUBLE SERVICE.dwg