


# FLUSH ASSEMBLY DETAIL

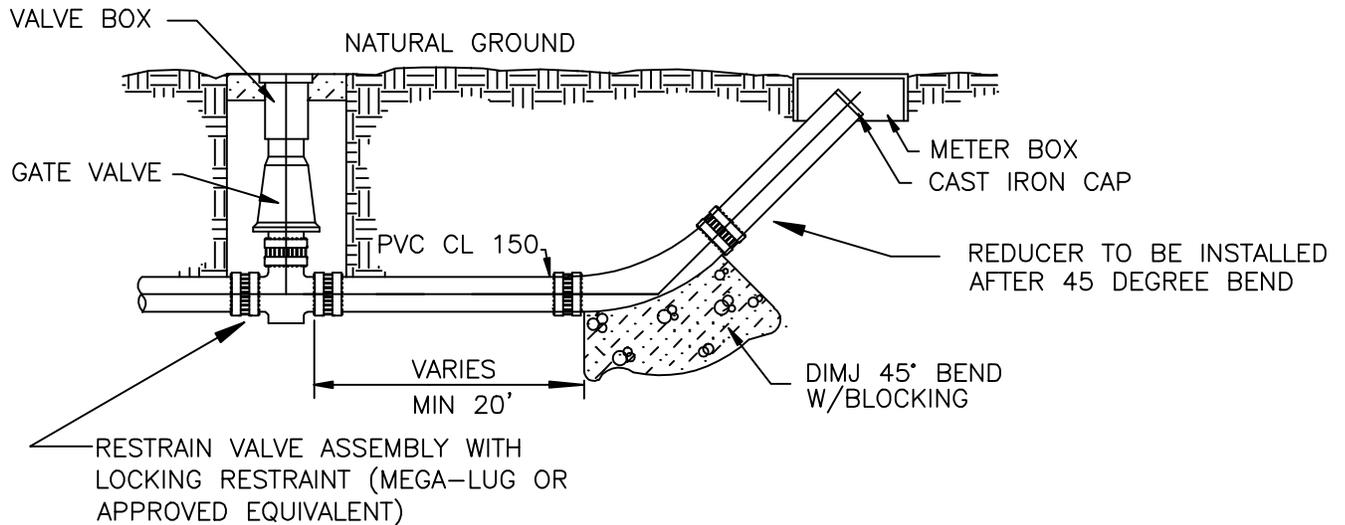

PIPE SIZE (IN)	REQUIRED GPM AT 2.5 FPS	FLUSH VALVE AND PIPE SIZE (IN)
6"	220	4"
8"	400	4"
10"	600	6"

FOR ALL OTHER PIPE SIZES, ENGINEER TO SPECIFY FLUSH VALVE AND PIPE SIZE PER AWWA C-651

SHEET 1 OF 1

		<b>CITY OF TEMPLE ENGINEERING DEPARTMENT</b>	
APPROVED BY: Michael Newman, P.E.	DATE APPROVED DATE:	3210 E. Avenue H, Bldg. A	TEMPLE, TX 76701-0402
DRAWN BY: Chris Peel	FILE NAME: FLUSHASSEMBLY.dwg	FLUSH ASSEMBLY DETAIL	SCALE: N.T.S.