


REHAB SEWER SERVICE CONNECTION

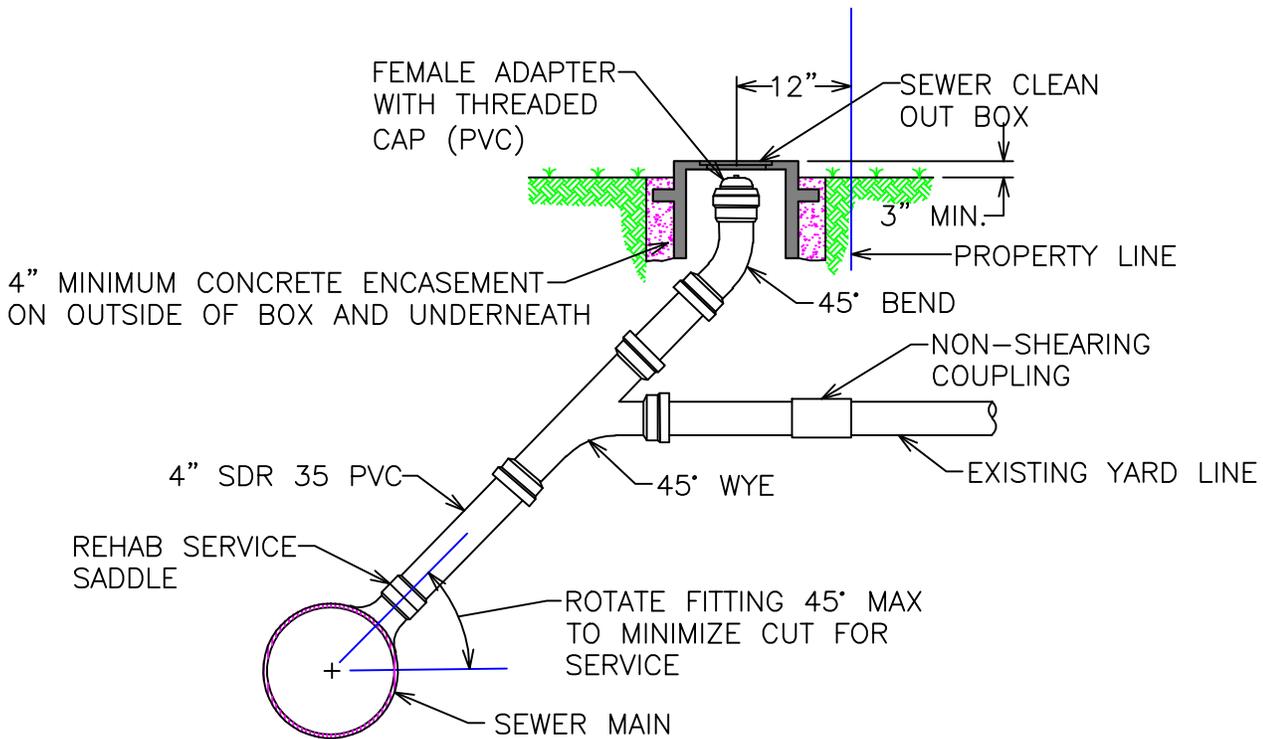

NOTE:

1. STANDARD CLEANOUT AND CAST IRON BOXES TO BE INSTALLED AT PROPERTY LINE ON SEWER SERVICE.
2. CAST IRON CLEANOUT BOX MUST BE SET FIRM IN CONCRETE & AT A MINIMUM OF 6" ABOVE FINAL GRADE.
3. CAST IRON SEWER CLEANOUT BOX WITH "SEWER" ON THE LID, WESTERN IRON WORKS MODEL #70, ACCUCAST LIDS #115901 OR PRE-APPROVED EQUAL AND INSTALLED USING CONCRETE AND PVC PIPE SLEEVE.
4. MUSHROOM CAP TO BE INSTALLED AT PROPERTY LINE.

SHEET 1 OF 1

APPROVED BY: Michael G. Newman, P.E.

DRAWN BY: Chris Peal

FILE NAME: SEWER CLEANOUT FOR SEWER SERVICE CONNECTION.dwg



**CITY OF TEMPLE
ENGINEERING DEPARTMENT**

3210 E. Avenue H, Bldg. A

TEMPLE, TX. 76801-8402

CLEANOUT FOR SEWER CONNECTION

SCALE:
N.T.S.