


RESIDENTIAL WATER SERVICE

SHORT AND LONG
COPPER AND HDPE SERVICE (TYPICAL)

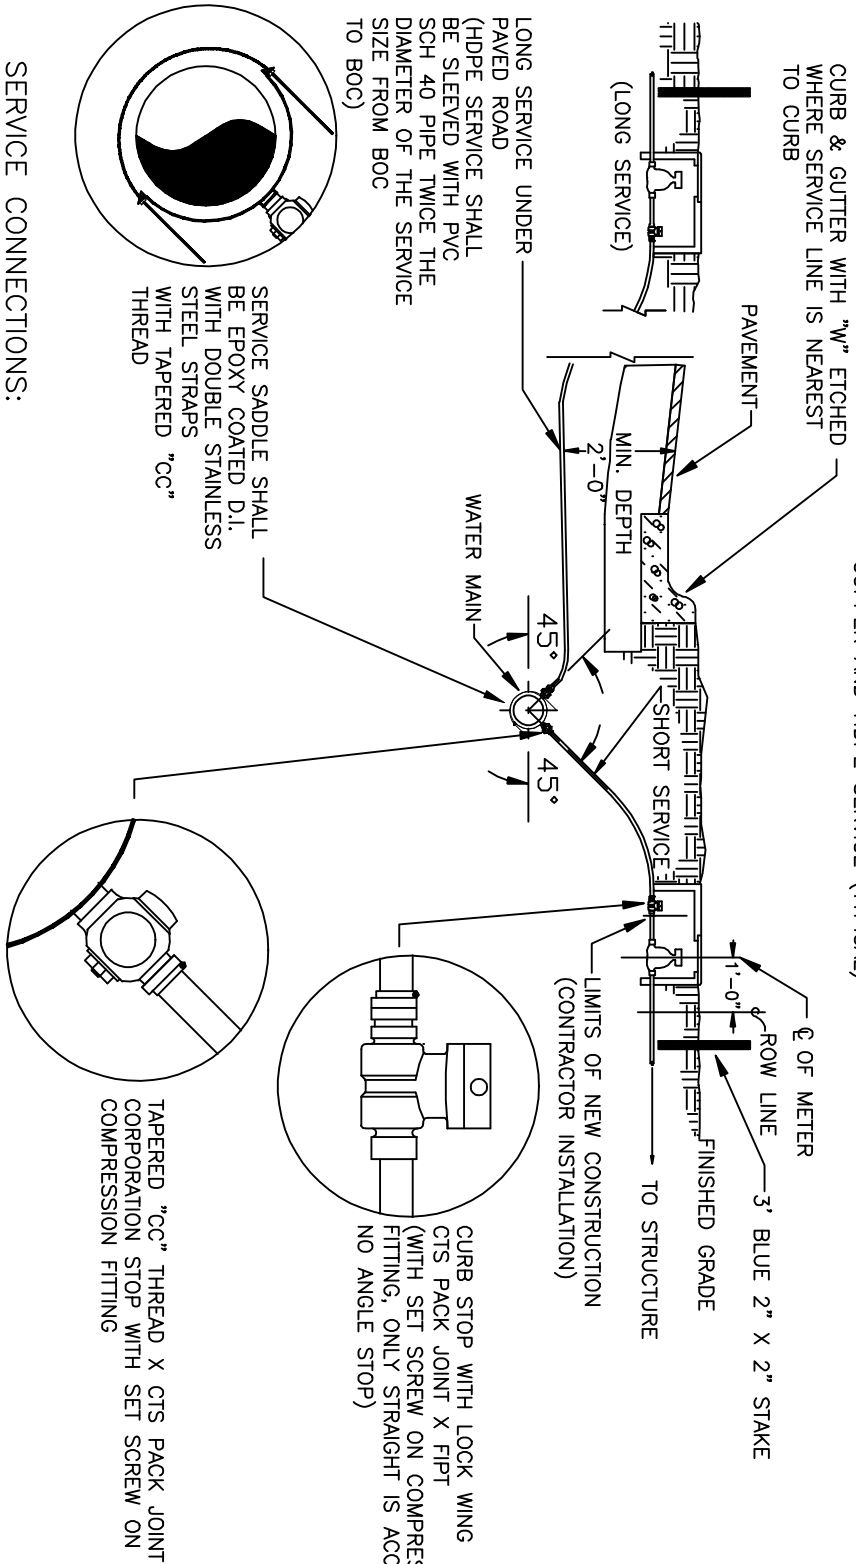

SERVICE CONNECTIONS:

1. SERVICE TAPS REQUIRE DOUBLE STAINLESS STEEL, EPOXY COATED DUCTILE IRON SERVICE SADDLE WITH TAPERED (CC) THREADS
2. SUBSTITUTION OF HDPE PIPE FOR SERVICES SHALL BE PERMITTED AFTER APPROVAL BY THE DIRECTOR OF UTILITIES WITH MATERIAL SPECIFICATIONS AND SAMPLE SUBMITTAL
3. CURB STOPS WILL BE STRAIGHT LOCKING TYPE AND HAVE A BALL CORPORATION VALVE WITH A SET SCREW COMPRESSION FITTING ON THE PACK JOINT
4. 3/6" X 2" X 2" STAKE PAINTED BLUE MUST BE INSTALLED AT ALL WATER SERVICES.
5. A MIN. OF 12" OF COVER ON ALL SERVICE LINES.

SHEET 1 OF 1

CITY OF TEMPLE
ENGINEERING DEPARTMENT

2210 E. Avenue H, Bldg. A

TEMPLE, TX 76801-8462

RESIDENTIAL WATER
DETAIL

SCALE:
N.T.S.



APPROVED BY: Michael Newman, P.E.

DEAD APPROVED DATE:

DRAWN BY: Chris Paul

FILE NAME: RESIDENTIAL WATER.dwg